 MicroMetl	DATE:	WEIGHT (LBS):	DESCRIPTION:	PART NUMBER:
	10/2019	326	CURB ADAPTER ASSEMBLY	CA-CAR-HE3F-CAR-528-RT-24

SUBMITTED TO:	COMPANY:	JOB NAME:	APPROVED BY:	DATE:
---------------	----------	-----------	--------------	-------

EXISTING UNIT:	NEW UNIT:
----------------	-----------

CURB ADAPTER INFORMATION:

1. BEFORE ORDERING CURB ADAPTER, CONTRACTOR MUST CONFIRM THE DIMENSIONS OF THE EXISTING CURB ON THIS DRAWING

2. BEFORE NEW HVAC UNIT IS SET IN PLACE, INSPECT STRUCTURAL STABILITY OF EXISTING CURB AND BUILDING'S ROOF LOAD CAPABILITY. REINFORCE IF REQUIRED.


3. ALL CURB ADAPTERS WILL INCREASE THE SYSTEM'S EXTERNAL STATIC PRESSURE AND MUST BE INCLUDED WHEN CALCULATING UNIT REQUIREMENTS

CFM	5,000	6,000	7,000
STATIC LOSS	0.051	0.074	0.100


NOTE: STATIC PRESSURE LOSS DATA IS BASED ON SIMULATED ANALYSIS WHICH INCLUDES BOTH SUPPLY AND RETURN

FEATURES:


- FULLY WELDED HEAVY GAUGE CONSTRUCTION
- TRANSITIONS INCLUDED
- FULL INTERNAL INSULATION
- GASKET PACKAGE INCLUDED

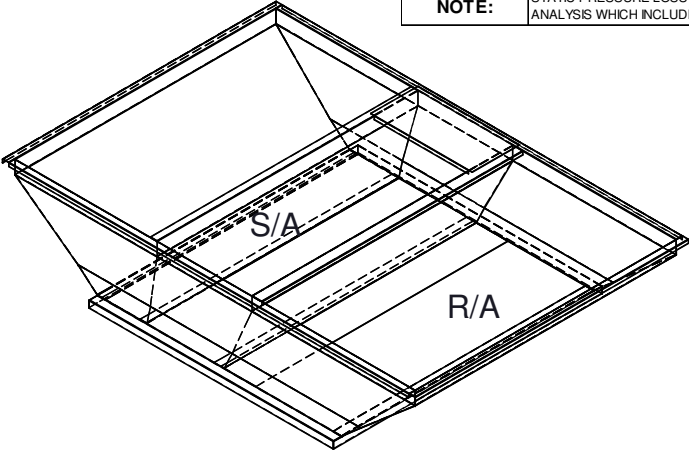

EXISTING CURB TOP VIEW

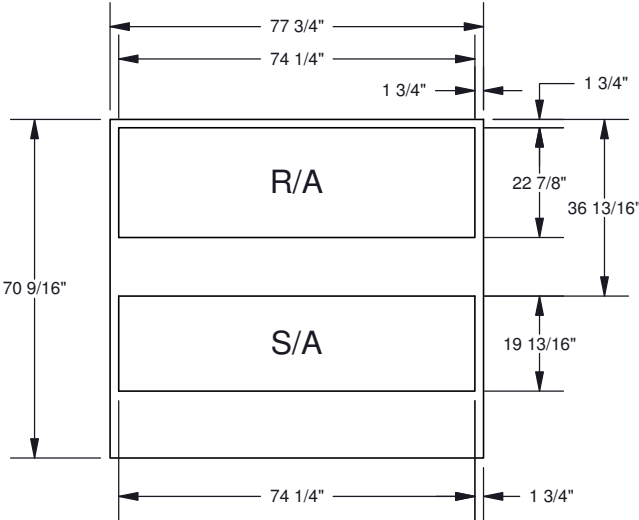

ADAPTER END VIEW

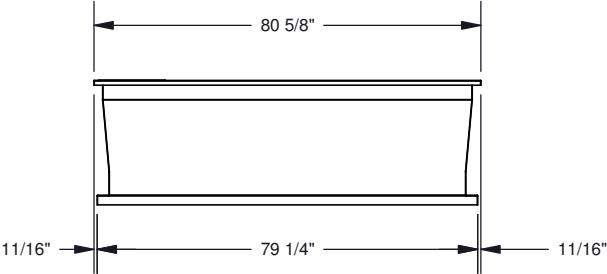

ADAPTER SIDE VIEW

