


USER GUIDE

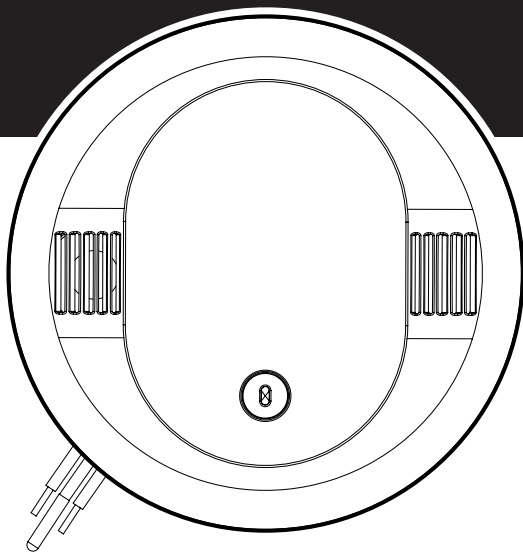

Smoke and Combination Smoke/CO Alarms

Models included in this User Guide:

Kidde Model	Type	120VAC	AA Backup Batteries	10 Yr Sealed Battery Backup	Voice
20SAR	Smoke	Yes	Yes	No	No
20SA10	Smoke	Yes	No	Yes	No
20SA10-V	Smoke	Yes	No	Yes	Yes
30CUAR	Smoke / CO	Yes	Yes	No	No
30CUAR-V	Smoke / CO	Yes	Yes	No	Yes
30CUA10	Smoke / CO	Yes	No	Yes	No
30CUA10-V	Smoke / CO	Yes	No	Yes	Yes
Firex Model	Type	120VAC	AA Backup Batteries	10 Yr Sealed Battery Backup	Voice
SMACFEX	Smoke	Yes	Yes	No	No
SMAC10YFEX	Smoke	Yes	No	Yes	No
CUACFEX	Smoke / CO	Yes	Yes	No	No
CUACFEX-V	Smoke / CO	Yes	Yes	No	Yes
CUAC10YFEX	Smoke / CO	Yes	No	Yes	No
CUAC10YFEX-V	Smoke / CO	Yes	No	Yes	Yes

Products are tested and certified to UL 217 (smoke models) or UL 217 and UL 2034 (combination smoke/CO models).



Thank You for Purchasing this Alarm

These models utilize standard 120V AC power, as well as either AA replaceable backup batteries or a 10 yr sealed battery backup. They also contain HUSH™ to temporarily silence nuisance alarms, and “self-testing” features (see Operation and Testing section). Certain models include a voice message system.

Teach children how to respond to the alarm and that they should never play with the unit. This alarm is a multi-criteria device. Smoke models are designed to detect smoke, and combination smoke/CO models are designed to detect both smoke and carbon monoxide from any source of combustion in a residential environment. It is not designed for use in a recreational vehicle (RV) or boat.

NOTE: Please thoroughly read this user guide and save the document for future reference and to pass on to any subsequent owner. Images are representative only. Actual product may vary slightly.

The National Fire Protection Association (NFPA) and the manufacturer recommend replacing this alarm after ten years.



**Scan here to register your device
with Kidde for customer support
and warranty information.**

Product Support: 1-800-880-6788

*Please write down the below information
and have this at hand when you call.*

Model: _____

Date Code (on back): _____

Date of Purchase: _____

Where Purchased: _____

Date to Replace: _____

Contents

1. Smoke Alarm: What To Do When The Alarm Sounds5
2. Other Alarm Visual And Audible Indicators6
3. Troubleshooting Guide7
4. Introduction, Product Features And Specifications8
5. Limitations Of Smoke And Carbon Monoxide Alarms8
6. Recommended Locations For Smoke And Carbon Monoxide Alarms10
7. Locations To Avoid13
8. Alarm Installation14
9. Operation And Testing19
10. Recognizing Nuisance Alarms20
11. Battery Information21
12. Permanently Disable Alarm / Discharge Battery (10 yr sealed battery models only) . .	.23
13. Carbon Monoxide Alarm: What To Do When The Alarm Sounds25
14. General Carbon Monoxide (CO) Information26
15. Cleaning Your Alarm28
16. Good Safety Habits29
17. Service And Warranty31

1. Smoke Alarm: What To Do When The Alarm Sounds

The smoke alarm pattern is three long beeps with voice “Fire!” (voice models only), a 1.5 second pause, and three long beeps repeating. The red LED blinks in time with the alarm pattern only on the alarm(s) that detected the hazard (initiating alarm).

The smoke alarm takes precedence when both smoke and carbon monoxide are present. (Only combination smoke/CO models detect carbon monoxide.)

- Alert small children in the home as well as anyone else that might have difficulty recognizing the importance of the alarm sounding or that might have difficulty leaving the area without help.
- Plan two ways out! Leave immediately by your escape plan. Don't waste time getting dressed or picking up valuables.
- While leaving, don't open any inside door without first feeling its surface. If hot, or if you see smoke seeping through cracks, don't open that door! Instead, use your alternate exit. If the inside of the door is cool, place your shoulder against it, open it slightly and be ready to slam it shut if heat and smoke rush in.
- If the escape route requires you to go through smoke, stay close to the floor where the air is cleaner. Crawl if necessary, and breathe shallowly through a cloth, wet if possible.
- Once outside, go to your selected meeting place and make sure everyone is there.
- Call the fire department or 911 from your cell phone outside, or from your neighbor's home-not from yours!
- Don't return to your home until the fire officials say that it is all right to do so.

NOTE: See Section RECOGNIZING NUISANCE ALARMS, for nuisance alarm situations.

2. Other Alarm Visual And Audible Indicators

Operational Mode	Visual Indications	Audible Indications	Action/Note
Normal (standby)	AC power: Green LED on continuously. DC power: Green LED blinks approx every 60 sec.		
Test (button press when no alarm condition is present) (Note: Test is very loud, stand a few feet away.)	Red LED blinks in time with alarm pattern.	<u>Non-Voice Smoke Models:</u> <ul style="list-style-type: none"> • Single beep • 3 long beeps, pause, 3 long beeps <u>Voice Smoke Models:</u> <ul style="list-style-type: none"> • Single beep • 3 long beeps, voice "Fire!," 3 long beeps <u>Non-Voice Combination Smoke/CO Models:</u> <ul style="list-style-type: none"> • Single beep • 3 long beeps, pause, 3 long beeps, 4 quick beeps, pause, 4 quick beeps. <u>Voice Combination Smoke/CO Models:</u> <ul style="list-style-type: none"> • Single beep • 3 long beeps, voice "Fire!," 3 long beeps, 4 quick beeps, voice "Warning, Carbon Monoxide," 4 quick beeps. 	Perform Test/Hush button press once a week to verify proper alarm operation.
Smoke or CO Alarm Memory (unit has experienced a smoke or CO alarm event, or has detected 100ppm CO or greater.) (CO only on combination smoke/CO models)	Smoke: Red LED blinks every 15 sec. CO (combination smoke/CO models only): 2 red LED blinks every 15 sec.	After Test/Hush button push: <u>Non-Voice Models:</u> None <u>Voice Models:</u> Voice "Smoke previously detected" or "Carbon monoxide previously detected." (combination smoke/CO models only)	NOTE: Alarm memory is only retained for 24 hrs. Push Test/Hush button to clear Alarm Memory.
Smoke Alarm Hush™ Mode	Red LED blinks every 2 sec (only on the initiating alarm).	After Test/Hush button push: <u>Non-Voice Models:</u> Smoke alarm pattern stops. If there is too much smoke to allow Hush™, smoke alarm pattern continues. <u>Voice Models:</u> Voice "Hush Mode Activated." Smoke alarm pattern stops. If there is too much smoke to allow Hush™, voice "Too much smoke, alarm cannot be hushed." (smoke alarm pattern continues)	This feature is to be used only when a known alarm condition, such as smoke from cooking, activates the alarm. Push button during Hush™ to clear Hush™ and perform a test.
CO Alarm Reset (combination smoke/CO models only)	None.	After Test/Hush button push: CO alarm pattern stops.	Unit is confirming if CO is present or if it experienced a nuisance situation. Re-alarm means danger. Move to fresh air and call 911.
Initiating Alarm (multiple alarms in an interconnected system)	Red LED blinks in time with alarm pattern indicating that this is the unit initiating the alarm in an interconnected, multiple alarm, system. NOTE: It is possible for more than one unit to detect a hazard and become an initiating alarm unit (Red LED blinking).	Unit in either Smoke or CO alarm mode.	

3. Troubleshooting Guide

If you are experiencing a problem with your alarm, or a fault, and are unsure of the next action, please contact product support at 1-800-880-6788 before discharging the battery (10 yr sealed battery models) or disposing of your alarm. You may also write us at: Kidde, 1016 Corporate Park Drive, Mebane, NC 27302, or visit our internet address at www.kidde.com.

Trouble Condition	Visual Indications	Audible Indications	Action / Note
False Low Battery or Missing Battery (AC power is connected before backup batteries activated, or when battery is missing)	Amber LED blinks every 60 sec.	Chirp and voice "Activate Battery" every 60 sec. After 1 hour, voice occurs only once every 15 mins. (Voice only on voice models)	<ul style="list-style-type: none"> * For AA replaceable battery models, remove the battery pull tab, or install batteries. * For 10 yr sealed battery models, activate the sealed battery backup.
Low Battery	Amber LED blinks every 60 sec.	<u>Replaceable AA Battery Models:</u> Chirp and voice "Low Battery" every 60 sec. <u>10 yr Sealed Battery Models:</u> Chirp and voice "Replace Alarm" every 60 sec. After 1 hour, voice occurs only once every 15 mins. After Test/Hush button push, voice "Hush Mode Activated." (Voice only on voice models)	<ul style="list-style-type: none"> * Push Test/Hush button once to silence for 24 hrs. (Push Test/Hush button again to clear Hush™ and perform a test.) Note: 7 days after Low Battery begins, the notifications cannot be silenced. * For AA replaceable battery models, replace batteries as soon as possible. * For 10 yr sealed battery models, remove alarm, discharge, dispose unit, and replace as soon as possible.
Smoke Sensor Fault	Amber LED blinks every 60 sec.	3 chirps every 60 sec and voice "Smoke Sensor Error." After 1 hour, voice occurs only once every 15 mins. (Voice only on voice models)	<ul style="list-style-type: none"> * See Cleaning Your Alarm section. * Push Test/Hush button once to attempt to reset the unit. * If error continues, remove alarm, dispose unit, and replace as soon as possible. (Remove AA batteries or discharge 10 yr sealed battery before disposal)
CO Fault (combination smoke/CO models only)	Amber LED blinks 2 times every 60 sec.	3 chirps every 60 sec and voice "Replace Alarm." After 1 hour, voice occurs only once every 15 mins. (Voice only on voice models)	<ul style="list-style-type: none"> * Push Test/Hush button once to attempt to reset the unit. * If error continues, remove alarm, dispose unit, and replace as soon as possible. (Remove AA batteries or discharge 10 yr sealed battery before disposal)
Fatal Fault	Amber LED blinks 3 times every 60 sec.	3 chirps every 60 sec and voice "Replace Alarm." After 1 hour, voice occurs only once every 15 mins. (Voice only on voice models)	<ul style="list-style-type: none"> * Push Test/Hush button once to attempt to reset the unit. * If error continues, remove alarm, dispose unit, and replace as soon as possible. (Remove AA batteries or discharge 10 yr sealed battery before disposal)
End of Unit Life	Amber LED blinks 2 times every 60 sec.	2 chirps every 60 sec and voice "Replace Alarm." After 1 hour, voice occurs only once every 15 mins. Voice "Hush Mode Activated" after Test/Hush button push (first 7 days only). (Voice only on voice models)	<ul style="list-style-type: none"> * Push Test/Hush button once to silence for 24 hrs. (Push Test/Hush button again to clear Hush™ and perform a test.) Note: 7 days after End of Unit Life begins, the notifications cannot be silenced. * Remove alarm, dispose unit, and replace as soon as possible. (Remove AA batteries or discharge 10 yr sealed battery before disposal)
MCU Failure	None	Constant Tone	<ul style="list-style-type: none"> * Remove alarm, dispose unit, and replace as soon as possible. (Remove AA batteries or discharge 10 yr sealed battery before disposal)
Stuck Test/Hush Button	Amber LED blinks 4 times every 60 sec.	3 chirps every 60 sec.	<ul style="list-style-type: none"> * Push Test/Hush button to dislodge it from being stuck. If button cannot be unstuck, remove alarm, dispose unit, and replace as soon as possible. (Remove AA batteries or discharge 10 yr sealed battery before disposal)

4. Introduction, Product Features And Specifications

Introduction

This alarm detects products of combustion using a photoelectric sensor and carbon monoxide (on combination smoke/CO models only) using an electrochemical cell. Many times throughout this User Guide, we will refer to Carbon Monoxide as “CO.”

Ten (10) years after the unit was installed, powered up, and tested, this unit will automatically alert you that it is time to replace the unit. This is called “End of Unit Life” mode. See Troubleshooting Guide. To help identify the date to replace the unit, a label has been affixed to the side of the alarm. Write the “Install date” in the space provided, and then write in the “Replace by” date (10 years from initial power up) in permanent marker on the label prior to installing the unit. For combination smoke/CO models, two labels have been provided that have important information on what to do in case of a CO alarm. Place one label at eye level on a wall near the alarm after it is mounted, and one near a fresh air source such as a door or window, where you plan to gather after the alarm indicates the presence of carbon monoxide.

Product Features and Specifications:

- Powered by 120VAC (60 Hz, 42 mA max) wire-in connector with either 2 AA backup backup batteries or 10 yr sealed battery backup (see page 2 for details)
- Reduced nuisance alarms
- Self-testing (see Operation and Testing section)
- Voice message system (voice models only)
- Easy installation
- Hardwire Interconnectable to other compatible alarms
- Smoke Alarm Hush™
- Smoke Sensor: Photoelectric
- CO Sensor: Electrochemical (combination smoke/CO models only)
- Temperature Operating Range: 40°F (4.4°C) to 100°F (37.8°C)
- Humidity Operating Range: up to 95% (smoke models) and 10 to 95% (combination smoke/CO models) RH, non-condensing
- Audible Alarm: 85+ dB at 10', 3.0 to 3.5 KHz pulsing , with voice messages “Fire!” and/or “Warning! Carbon Monoxide” (voice only on voice models)

5. Limitations Of Smoke And Carbon Monoxide Alarms

WARNING: PLEASE READ CAREFULLY AND THOROUGHLY

- Life safety from fire in residential occupancies is based primarily on early notification to occupants of the need to escape, followed by the appropriate egress actions by those occupants.
- There are situations where a smoke alarm may not be effective to protect against fire as stated in the NFPA Standard 72. For instance:

- a) smoking in bed
- b) leaving children home alone
- c) cleaning with flammable liquids, such as gasoline
- Fire warning systems for dwelling units are capable of protecting about half of the occupants in potentially fatal fires. A smoke alarm may not be effective in some situations, such as during incendiary fires where the fire grows so rapidly that an occupant's egress is blocked even with properly located smoke alarms, or when victims are intimate with the fire (for example, when a person's clothes catch fire while cooking), too old or young, or physically or mentally impaired such that they cannot escape even when warned early enough that escape should be possible. For these people, additional strategies such as protection-in-place or assisted escape or rescue are necessary.*
- This model meets the latest residential smoke alarm standards, which includes enhanced resistance to nuisance alarms from cooking. Industry experts recommend that both ionization and photoelectric smoke alarms be installed to help ensure optimal detection of the various types of fires that can occur within the home. Ionization sensing alarms may detect invisible fire particles (associated with fast flaming fires) sooner than photoelectric alarms. Photoelectric sensing alarms may detect visible fire particles (associated with slow smoldering fires) sooner than ionization alarms.
- A battery powered alarm must have a battery of the specified type, in good condition and installed properly.
- Smoke alarms must be tested regularly to make sure the battery and the alarm circuits are in good operating condition.
- Smoke alarms cannot provide an alarm if smoke does not reach the alarm. Therefore, smoke alarms may not sense fires starting in chimneys, within walls, on roofs, on the other side of a closed door or other obstructions.
- If the alarm is located outside the bedroom or on a different floor, it may not wake up a sound sleeper.
- The use of alcohol or drugs may also impair one's ability to hear the smoke alarm. For optimal detection, a smoke alarm should be installed in each sleeping area on every level of a home.

This alarm is not intended to alert hearing impaired individuals.

* Reference National Fire Protection Association (NFPA) standard 72

⚠ WARNING: PLEASE READ CAREFULLY AND THOROUGHLY

IMPORTANT: Combination smoke/CO alarms are designed to detect carbon monoxide gas from ANY source of combustion. They are NOT designed to detect any other gas.

⚠ CAUTION: Combination smoke/CO alarms will only indicate the presence of carbon monoxide gas at the sensor. Carbon monoxide gas may be present in other areas. Never restart the source of a CO problem until it has been fixed. NEVER IGNORE THE ALARM!

⚠ WARNING: COMBINATION SMOKE/CO ALARMS ARE INTENDED FOR USE IN ORDINARY INDOOR LOCATIONS OF FAMILY LIVING UNITS. THEY ARE NOT DESIGNED TO MEASURE COMPLIANCE WITH OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION (OSHA)

COMMERCIAL OR INDUSTRIAL STANDARDS. THEY ARE NOT SUITABLE FOR INSTALLATION IN HAZARDOUS LOCATIONS AS DEFINED IN THE NATIONAL ELECTRIC CODE. THEY ARE NOT DESIGNED FOR USE IN A RECREATIONAL VEHICLE (RV) OR BOAT.

- The installation of combination smoke/CO alarms should not be used as a substitute for proper installation, use, and maintenance of fuel burning appliances, including appropriate ventilation and exhaust systems.
- Combination smoke/CO alarms do not prevent CO from occurring, nor can they solve any existing CO problem.

⚠ WARNING: COMBINATION SMOKE/CO ALARMS ARE DESIGNED TO HELP PROTECT INDIVIDUALS FROM ACUTE EFFECTS OF CARBON MONOXIDE EXPOSURE. THEY WILL NOT FULLY SAFEGUARD INDIVIDUALS WITH SPECIFIC MEDICAL CONDITIONS. IF IN DOUBT, CONSULT A MEDICAL PRACTITIONER. INDIVIDUALS WITH MEDICAL PROBLEMS MAY CONSIDER USING WARNING DEVICES WHICH PROVIDE AUDIBLE AND VISUAL SIGNALS FOR CARBON MONOXIDE CONCENTRATIONS UNDER 30 PPM. *

- Combination smoke/CO alarms have not been investigated for carbon monoxide detection below 70 PPM.
- This device requires a continuous supply of electrical power from a healthy battery or AC connection, depending on the model. It will not work without power.

* Reference Underwriters Laboratories (UL) standard 2034

6. Recommended Locations For Smoke And Carbon Monoxide Alarms

- Locate smoke alarms in all sleeping areas. Try to monitor the exit path as the bedrooms are usually farthest from the exit. If more than one sleeping area exists, locate additional alarms in each sleeping area.
- Locate additional alarms in stairways, because stairways act like chimneys for smoke and heat.
- Locate at least one alarm on every floor level.
- Locate an alarm in every bedroom.
- Locate an alarm in every room where electrical appliances are operated (i.e. portable heaters or humidifiers).
- Locate an alarm in every room where someone sleeps with the door closed. The closed door may prevent an alarm not located in that room from waking the sleeper.
- Smoke, heat, and combustion products rise to the ceiling and spread horizontally. Mounting the smoke alarm on the ceiling in the center of the room places it closest to all points in the room. Ceiling mounting is preferred in ordinary residential construction.

- For mobile home installation, select locations carefully to avoid thermal barriers that may form at the ceiling. For more details, see MOBILE HOME INSTALLATION section.
- When mounting the alarm on the wall, use an inside wall with the top edge of the alarm at a maximum of 12" (30.5 cm) below the ceiling.



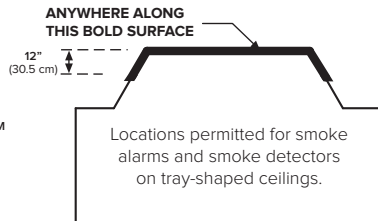


Figure 6-A

NFPA 72 states: "Smoke alarms in rooms with ceiling slopes greater than 1 ft in 8 ft (0.3m in 2.4 m) horizontally shall be located on the high side of the room." NFPA 72 states: "A row of detectors shall be spaced and located within 3 ft (0.9m) of the peak of the ceiling measured horizontally."

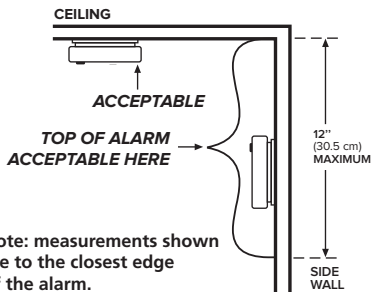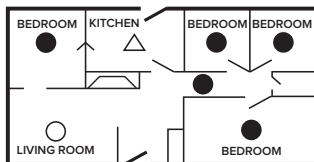

- Smoke Alarms for Required Detection
- Smoke Alarms for Additional Detection
- △ Not within 6 ft (1.8m) of appliances

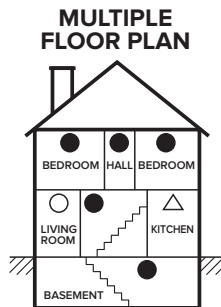


Figure 6-B

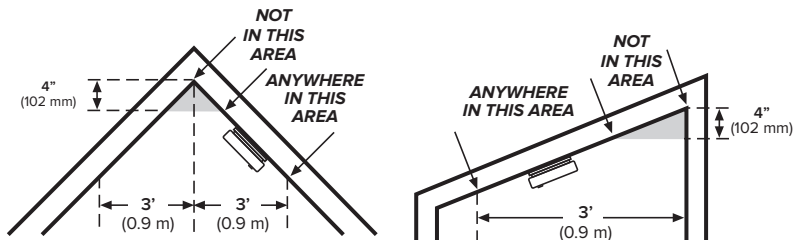


Figure 6-C

- Put smoke alarms at both ends of a bedroom hallway or large room if the hallway or room is more than 30ft (9.1 m) long.
- Install Smoke Alarms on sloped, peaked or cathedral ceilings at or within 3ft (0.9m) of the highest point (measured horizontally).
- Industry experts recommend a CO alarm be installed on each level of the home -- ideally on any level with fuel burning appliances and outside of sleeping areas.

This equipment should be installed in accordance with the National Fire Protection Association's 72 (National Fire Protection Association, Batterymarch Park, Quincy, MA 02269).

Mobile Home Installation

Modern mobile homes have been designed and built to be energy efficient. Install smoke alarms as recommended above. In older mobile homes that are not well insulated compared to present standards, extreme heat or cold can be transferred from the outside to the inside through poorly insulated walls and roof. This may create a thermal barrier which can prevent the smoke from reaching an alarm mounted on the ceiling. In such units, install the smoke alarm on an inside wall with the top edge of the alarm a maximum of 12" (30.5 cm) below the ceiling.

If you are not sure about the insulation in your mobile home, or if you notice that the outer walls and ceiling are either hot or cold compared to the room air temperature, install the alarm on an inside wall. NFPA 72 (National Fire Protection Association) requires smoke alarms be installed in each sleeping area.

⚠ WARNING: TEST YOUR ALARM OPERATION AFTER MOBILE HOME HAS BEEN IN STORAGE OR UNOCCUPIED, AND AT LEAST ONCE A WEEK DURING USE.

7. Locations To Avoid

(See Figures 6-A, 6-B, & 6-C for recommended locations)

- In the garage. Products of combustion are present when you start your automobile.
- Normal cooking may cause nuisance alarms. If a kitchen alarm is desired, it should have an alarm silence feature and should not be installed within 6 ft (1.8m) of cooking appliances.
- Do not install within 6 ft (1.8m) of heating appliances.
- Less than 4" (10cm) from the peak of an "A" frame type ceiling.
- In an area where the temperature may fall below 40°F (4.4°C) or rise above 100°F (37.8°C), such as garages and unfinished attics.
- In dusty areas. Dust particles may cause nuisance alarms or a failure to alarm.
- In very humid areas (above 95% RH, non-condensing) as moisture or steam can cause nuisance alarms.
- In insect-infested areas.
- Smoke alarms should not be installed within 3 ft (0.9m) of the door to a bathroom containing a tub or shower, forced air supply ducts used for heating or cooling, ceiling or whole house ventilating fans, or other high air flow areas.
- Near lights. Electronic "noise" generated by the lights may cause nuisance alarms.
- Do not install near vents, flues, or chimneys.
- Do not install near fans, doors, windows or areas directly exposed to the weather.
- Avoid installing where the unit will be exposed to direct sunlight.

NOTE: Smoke alarms are not to be used with detector guards unless the combination (alarm and detector guard) has been evaluated and found suitable for that purpose.

8. Alarm Installation

NOTE: A dust cover has been installed on the alarm. Keep the dust cover on until all construction has been completed for at least 24 hours (drywall, painting, varnishing, mounting plate install, etc). Retain the dust cover and re-install it to protect the alarm during future construction projects. Construction dust and chemicals can cause contamination and false alarms.

⚠ WARNING: DUST COVER MUST BE REMOVED FOR ALARM TO OPERATE.

NOTE: Single station alarms are units that are not connected to other alarms in any manner, including hardware interconnect. Single station alarms (including these models, IF USED as a single station alarm) CANNOT send or receive alarm signals to other alarms in your home.

STEP 1: Wiring

Wiring Requirements

- AC alarms should be installed on a UL Listed or recognized junction box. All connections should be made by a qualified electrician and all wiring used shall be in accordance with articles 210 and 300.3(B) of the U.S. National Electrical Code ANSI/NFPA 70, NFPA 72 and/or any other codes having jurisdiction in your area. The multiple station interconnect wiring to the alarms must be run in the same raceway or cable as the AC power wiring. In addition, the resistance of the interconnect wiring shall be a maximum of 10 ohms.
- The maximum wire run distance between the first and last unit in an interconnected system is 1000 feet.
- The appropriate power source is 120 Volt AC Single Phase supplied from a non-switchable circuit.
- These alarms are not designed, agency tested or certified for recessed mounting and should not be installed in this manner. Recessed mounting impedes smoke entry into the smoke chamber, which may prevent the alarm from sounding in a timely manner. This could endanger the lives of occupants in the residence. These alarms are designed, tested and certified for wall (if applicable) and ceiling surface mount only.

⚠ WARNING: AC ALARMS CANNOT BE OPERATED FROM POWER DERIVED FROM A SQUARE WAVE, MODIFIED SQUARE WAVE OR MODIFIED SINE WAVE, INVERTER. THESE TYPES OF INVERTERS ARE SOMETIMES USED TO SUPPLY POWER TO THE STRUCTURE IN OFF GRID INSTALLATIONS, SUCH AS SOLAR OR WIND DERIVED POWER SOURCES. THESE POWER SOURCES PRODUCE HIGH PEAK VOLTAGES THAT WILL DAMAGE THE ALARM.


Wiring Instructions for AC Quick Connector Harness

⚠ CAUTION: Turn off the main power to the circuit before wiring the alarm.

- For alarms that are used as single station, DO NOT CONNECT THE RED WIRE TO ANYTHING. Leave the red wire insulating cap in place to make certain that the red wire cannot contact any metal parts or the electrical box.
- When alarms are hardwire interconnected, all interconnected units must be powered from a single circuit.
- A maximum of 24 Kidde Safety devices may be interconnected in a multiple station arrangement. The interconnect system should not exceed the NFPA interconnect limit of 12 smoke or smoke/CO combination alarms and/or 18 alarms total (smoke, CO, smoke/CO combination, heat, etc.). With 18 alarms interconnected, it is still possible to interconnect up to a total of 6 remote signaling devices and/or relay modules.
- Figure 8-A illustrates interconnection wiring. Improper connection will result in damage to the alarm, failure to operate, or a shock hazard.
- Make certain alarms are wired to a continuous (non-switched) power line.

FUSE OR CIRCUIT BREAKER

Figure 8-A, Interconnect Wiring Diagram

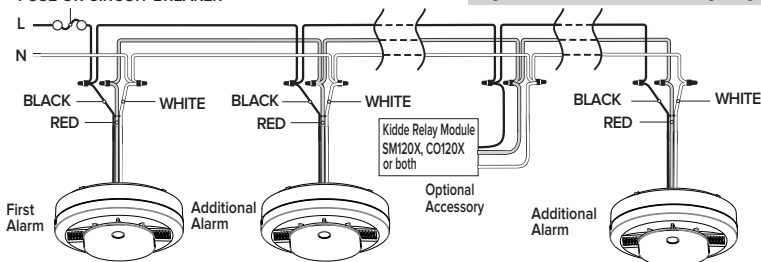

Wires on alarm harness: Connected to:
 Black: Hot side of AC line
 White: Neutral side of AC line
 Red: Interconnect lines (red wires) of other units in the multiple station set-up




Figure 8-B

NOTE: Use standard UL Listed household wire (as required by local codes) available at all electrical supply stores and most hardware stores.

NOTE: AC power should be turned off at this stage.

- For best results to minimize nuisance alarms, interconnected alarms should be on a dedicated line. If not on a dedicated line, it is suggested that the smoke alarms share a lighting load circuit that

does not have a dimmer associated with it. If receptacles must be placed on the same line it is suggested that they be placed ahead of the smoke alarms (see Figure 8-B). This will prevent large voltage drops from occurring between the first and last alarm in the circuit.

STEP 2: Activate Battery

AA replaceable battery models:

Pull out the battery pull tab first to activate the batteries (see Figure 8-C). Battery activation is confirmed with a beep. If the beep does not occur when the battery pull tab is removed, remove the batteries and reinstall them. Confirm the battery activation beep.



Figure 8-C

10 yr sealed battery models:

One of the following steps must be taken to ensure activation: Battery activation is confirmed with a beep. Confirm the battery activation beep.

A. Activate the alarm battery by rotating the alarm fully onto the mounting bracket in a clockwise direction. (reference Figures 8-F and 8-G) To allow for installation, battery will remain active when unit is removed from mounting bracket.

-- OR --

B. Activate the alarm by locating the red wheel on the back of the unit - turn the red wheel to the "ON" position using a standard screwdriver. (see Figure 8-D). Battery will remain active to allow for installation on mounting bracket.




Figure 8-D

NOTE: Attaching AC power first, without removing the battery pull tab, or without installing all batteries in the correct orientation, or without activating the 10 yr sealed battery backup, will result in a false low battery trouble condition chirp (see Troubleshooting Guide). You need to activate or install the batteries to eliminate the false low battery trouble condition chirps. Remove the battery pull tab (see Figure 8-C), or activate the 10 yr sealed battery backup (see Figure 8-D), or install batteries (see Figure 11-B) to avoid false low battery notification.

STEP 3: Install Mounting Bracket

- After selecting the proper location for your alarm, and wiring the AC QUICK CONNECTOR harness as described previously, attach the mounting bracket to the electrical box using the existing screws. To ensure aesthetic alignment of the alarm with the hallway, or wall, the "A" line on the mounting bracket should be parallel with the hallway when ceiling mounted or horizontal when wall mounted. (See Figure 8-E)
- Pull the AC QUICK CONNECTOR through the center hole in the mounting bracket and secure the bracket, making sure that the mounting screws are positioned in the small ends of the keyholes before tightening the screws. (See Figure 8-E)

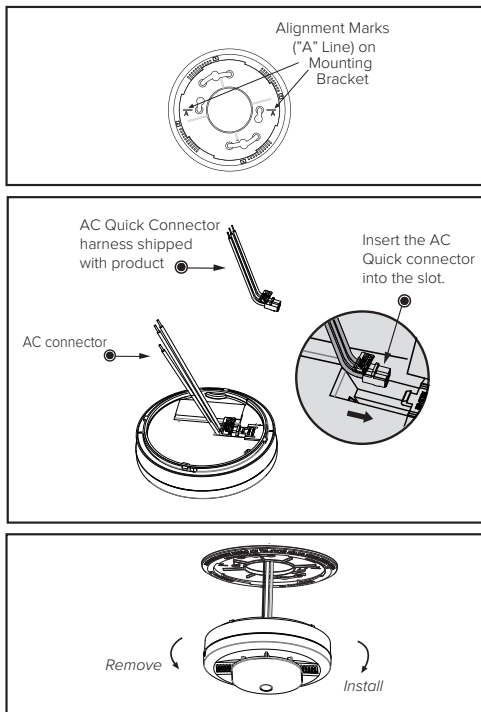


Figure 8-E

STEP 4: Attach AC Quick Connector

Plug the AC QUICK CONNECTOR into the back of the unit, making sure that the connector snaps into place. Then push the excess wire back into the electrical box through the hole in the center of the mounting bracket.

STEP 5: Install Alarm

Install the alarm fully on the mounting bracket by rotating the alarm in a clockwise direction (Figure 8-G).

NOTE: The alarm will mount to the bracket in 4 positions (every 90 degrees).

NOTE: If either battery is missing (AA battery models), the alarm cannot mount on the mounting bracket.

NOTE: Do not grab the shield to install or remove the alarm. Grab the alarm by the outside of the enclosure (Figure 8-F).

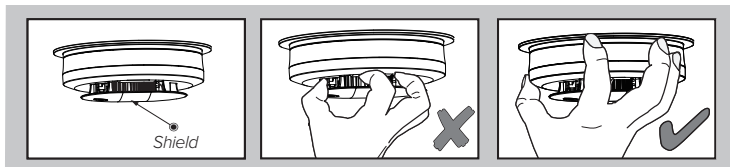


Figure 8-F

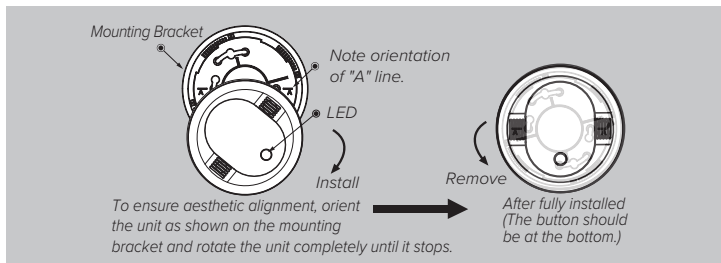


Figure 8-G

STEP 6:

Turn on the AC power. The green LED will illuminate when AC power is applied.

AC models have AC hardwire interconnect capability. When one hardwired interconnect unit sounds an alarm, all other compatible hardwire or interconnected units will also alarm.

The following models can be interconnected using the standard AC wiring interconnect (Refer to each model's user guide for visual and audible indicators):

Models which provide remote smoke alarms, but not remote CO alarms: HD135F, i12020, i12020A, i12040, i12040A, i12060, i12060A, i12080, i12080A, i4618A, i4618AC, P12040, PE120, Pi2000, Pi2010.

SM120X relay module will only activate from interconnect smoke signal.

The alarm is now activated! After installation / activation, test your alarm as described in Operation and Testing section.

9. Operation And Testing

Operation

The alarm is operating once it is activated and testing is complete (see “TESTING” below). When products of combustion (smoke for smoke only models, and smoke or CO for combination smoke/CO models) are sensed, the unit sounds a loud alarm with voice messages. (Voice only on voice models) See Sections 1 and 2 for alarm signal descriptions. In high levels of CO, the unit levels of CO (combination smoke/CO models only

At 70 PPM, the unit must alarm within 60-240 minutes.
At 150 PPM, the unit must alarm within 10-50 minutes.
At 400 PPM, the unit must alarm within 4-15 minutes.

(Combination smoke/CO models only)

Testing

⚠ WARNING: Do not attempt to test this unit with retail “canned smoke” products. Those products are intended for use by trained professionals and produce inconsistent results when misused. Over-application of canned smoke can permanently damage the alarm.

Self-Testing

This model is equipped with internal, self-testing components that are always checking to ensure the device is operating as expected. (Weekly manual testing is still required. See below.)

Manual Testing

NOTE: When pushing the Test/Hush button, use only your finger or thumb. Using any other instrument(s) (such as a broom handle) is strictly prohibited, as it may damage the alarm.

Test your alarm weekly by pressing and releasing the Test/Hush button quickly. A quick beep will confirm the Test/Hush button has been pushed followed by the test sequence. See Other Alarm Visual and Audible Indicators table. The alarm and voice (and any interconnected units) will sound if the electronic circuitry, horn, speaker, and batteries are working. If the alarm or voice does not sound, or gives erratic or low volume sound, the unit must be replaced. (Voice only on voice models)

⚠ WARNING: Due to the loudness of the alarm, always stand about 2.5 ft (0.8 m) away from the unit or use ear protection when testing.

⚠ WARNING: Do not use an open flame to test your alarm, you could damage the alarm or ignite combustible materials and start a structure fire.

Chirping

When End of Unit Life or Low Battery chirping begins, you can temporarily silence these chirps by pressing the Test/Hush button. Other fault /error chirps cannot be silenced. Take appropriate action as described in the Troubleshooting Guide.

⚠ WARNING: REPLACE UNIT AS SOON AS POSSIBLE WHEN IN END OF UNIT LIFE. SEVEN (7) DAYS AFTER END OF UNIT LIFE BEGINS, THE NOTIFICATIONS CANNOT BE SILENCED, AND SMOKE AND/OR CO DETECTION CANNOT BE GUARANTEED. REPLACE IMMEDIATELY!

10. Recognizing Nuisance Alarms

Smoke Nuisance

This model meets the latest residential smoke alarm standards, which includes enhanced resistance to nuisance alarms from cooking.

HUSH™: If you know why the alarm is sounding, and you can verify that it is not a life threatening situation, you can push the button on the initiating unit to silence the alarm for 8-10 minutes. If the

smoke is not too dense, that unit, and all interconnected units will silence. After the Hush™ period, the smoke alarm will automatically reset and sound the alarm if particles of combustion are still present. You can use Hush™ repeatedly until the air has been cleared of the condition causing the alarm.

NOTE: Dense smoke will override Hush™ and sound a continuous alarm. If no fire is present, check to see if one of the reasons listed in “Locations to avoid” may have caused the alarm. If a fire is discovered, get out and call the fire department or 911.

Cigarette smoke will not normally cause the unit to alarm, unless the smoke is blown directly into the alarm. Combustion particles from cooking may set off the alarm if it is located too close to a cooking appliance. Large quantities of combustible particles are generated from spills or when broiling. Using the fan on a range hood which vents to the outside (non-recirculating type) will also help prevent nuisance alarms from occurring by removing these combustible products from the kitchen.

Carbon Monoxide (CO) Nuisance (combination smoke/CO models only)

RESET: Pushing the Test/Hush button on a combination smoke/CO unit during CO alarm allows the unit to reset calculations and double check for the presence of CO. If the unit re-alarms within 6 minutes, it is sensing high levels of CO which can quickly become a dangerous situation. Move to fresh air and call 911.

NOTE: Smoke only models do not detect CO, but will receive and transmit a CO alarm signal from an interconnected CO or combination smoke/CO alarm. Pushing the button on a smoke only model when it is transmitting an interconnected CO alarm signal will do nothing.

⚠ WARNING: ALTHOUGH RESET FEATURE CAN BE USED FOR CO ALARM EVENTS, IT IS IMPOSSIBLE TO DETERMINE THE SOURCE OF A CO ALARM USING SIGHT OR SMELL. ALWAYS CONSIDER A CO ALARM EVENT AS DANGEROUS.

11. Battery Information

AA Replaceable Battery Models:

These models are powered with AC power, but also contain two replaceable AA backup batteries. Under normal conditions, fresh batteries will last at least one year. **NOTE:** Constant exposure to high or low humidity or temperatures may reduce battery life.

⚠ WARNING: THE ALARM IS SEALED AND THE COVER IS NOT REMOVABLE.

In order to access the battery compartment, the wiring harness needs to be removed. To release the wiring harness, press down on the tab as shown in Figure 11-A.

LOW BATTERY

This alarm is equipped with a low battery monitor circuit. If the battery capacity is nearing the point where it can no longer provide adequate power for all alarm functions, the low battery condition will occur. See Troubleshooting Guide. The batteries must be replaced within 7 days of the first occurrence of the “Low Battery Warning” to provide continuous alarm detection.

Replace batteries with one of the following approved brands:

Energizer E91, Gold Peak 15A or Golden Power GLR6A.

These batteries can be purchased at your local retailer.

⚠ WARNING: Use only the batteries specified. Use of different batteries may have a detrimental effect on the alarm. Do not mix old and new batteries. Do not mix alkaline, standard, or rechargeable batteries.

NOTE: Do not use lithium batteries in this unit. A good safety measure is to replace the batteries at least once a year, or at the same time you change your clocks for daylight saving time. Loss of AC power and a missing or improperly installed battery will render the unit inoperable.

10 yr Sealed Battery Models:

These models are powered with AC power, but also contain a sealed lithium battery backup system. No battery installation or replacement is necessary for the life of the alarm. **NOTE:** Constant exposure to high or low humidity or temperatures may reduce battery life.

⚠ WARNING: NO SERVICEABLE PARTS INCLUDED. DO NOT ATTEMPT TO OPEN THE ALARM FOR ANY REASON! DO NOT TRY TO REPAIR THE ALARM YOURSELF.

LOW BATTERY

This alarm is equipped with a low battery monitor circuit. If the battery capacity is nearing the point where it can no longer provide adequate power for all alarm functions, the low battery condition will occur. See Troubleshooting Guide. The unit must be replaced within 7 days of the first occurrence of the “Low Battery Warning” to provide continuous alarm detection.

⚠ CAUTION: THE BATTERY USED IN THIS DEVICE MAY PRESENT A FIRE OR CHEMICAL BURN HAZARD IF MISTREATED. DO NOT RECHARGE, DISASSEMBLE, HEAT ABOVE 100°C (212°F) OR DISPOSE OF IN FIRE.

⚠ WARNING: Failure to properly connect AC power and install batteries in the correct orientation, or activate the 10 yr battery backup, will prevent proper operation of this alarm and will prevent its response to fire and/or CO hazards.




Figure 11-A




Figure 11-B


12. Permanently Disable Alarm / Discharge Battery

(10 yr sealed battery models only)

⚠ WARNING: FAILURE TO DISCHARGE ALARM BATTERY AS INSTRUCTED PRIOR TO DISPOSAL MAY CREATE POTENTIAL FOR LITHIUM BATTERY RELATED FIRE OR HAZARD.

⚠ WARNING: DISCHARGING THE ALARM BATTERY IS PERMANENT

- Once the alarm battery has been discharged, it cannot be reactivated!
- Once discharged, the alarm will NO LONGER DETECT SMOKE OR CO. (only combination smoke/CO models detect CO)
- Once the alarm battery is discharged, the battery is depleted and the alarm will no longer function.
- Once the alarm battery has been discharged, the alarm cannot be mounted onto the mounting bracket or reactivated.

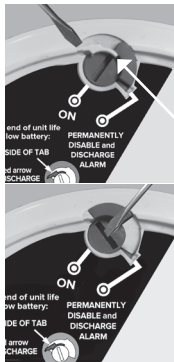

To Permanently Disable Alarm / Discharge Battery:

- Rotate the alarm counterclockwise to remove it from the mounting bracket.
- Disconnect AC wiring harness.
- Remove SIDE OF TAB from base.
- After the SIDE OF TAB is removed, use the screwdriver to turn the red slotted arrow to the "PERMANENTLY DISABLE and DISCHARGE ALARM" location until it clicks/locks into position. This will disable the alarm, stop the low battery or end of unit life "chirps" and render the alarm safe for disposal by draining the battery.

Figures 12-A (top) and 12-B (bottom)

Models that detect CO:

Kidde Model	Type	120VAC	AA Backup Batteries	10 Yr Sealed Battery Backup	Voice
30CUAR	Smoke / CO	Yes	Yes	No	No
30CUAR-V	Smoke / CO	Yes	Yes	No	Yes
30CUA10	Smoke / CO	Yes	No	Yes	No
30CUA10-V	Smoke / CO	Yes	No	Yes	Yes
Firex Model	Type	120VAC	AA Backup Batteries	10 Yr Sealed Battery Backup	Voice
CUACFEX	Smoke / CO	Yes	Yes	No	No
CUACFEX-V	Smoke / CO	Yes	Yes	No	Yes
CUAC10YFEX	Smoke / CO	Yes	No	Yes	No
CUAC10YFEX-V	Smoke / CO	Yes	No	Yes	Yes

13. Carbon Monoxide Alarm: What To Do When The Alarm Sounds

NOTE: Smoke only models do not detect carbon monoxide (CO), but will receive and transmit a CO alarm signal from an interconnected CO or combination smoke / CO alarm.

The carbon monoxide (CO) alarm pattern is four quick beeps with voice "Warning! Carbon Monoxide" (voice models only) repeating every 5 seconds. The red LED blinks in time with the alarm pattern only on the alarm(s) that detected the hazard (initiating alarm). On DC power only, after 4 minutes in CO alarm the alarm pattern will only occur every 60s.

▲WARNING: CARBON MONOXIDE (CO) IS A COLORLESS, ODORLESS, POISONOUS GAS. YOU CAN'T TASTE, SEE, OR SMELL CO, BUT IT CAN KILL IN JUST MINUTES. THIS ALARM WILL SOUND IN A 4-BEEP PATTERN IF LIFE THREATENING LEVELS OF CO ARE DETECTED. IF THE ALARM SOUNDS:

- 1) Immediately evacuate all occupants from the space and go outdoors to fresh air.
- 2) Call emergency responders (911 or fire department) for help; notify the building or vehicle owner, as necessary.

EMERGENCY PHONE #: _____

Always consider a CO alarm to be dangerous. After emergency services responders have arrived, the premises has been aired out, and your alarm remains in its normal condition, it is important to call a qualified appliance technician to investigate for sources of CO from fuel burning equipment and appliances and inspect for proper operation of this equipment. If problems are identified during this inspection, have the equipment serviced immediately. Note any combustion equipment not inspected by the technician and consult the manufacturer's instructions or contact the manufacturer directly for more information about CO safety and this equipment. Make sure that motor vehicles are not or have not been operating in an attached garage or adjacent to the residence.

NOTE: See Section RECOGNIZING NUISANCE ALARMS, for nuisance alarm situations.

14. General Carbon Monoxide (CO) Information

Carbon monoxide (CO) is a colorless, odorless, and tasteless poison gas that can be fatal when inhaled. CO inhibits the blood's capacity to carry oxygen.

Possible Sources of CO

Inside your home, appliances used for heating and cooking are the most likely sources of CO. Vehicles and other combustion engines running in an attached garage and using a charcoal/gas grill or hibachi in an enclosed area are all possible sources of CO. Generators running in enclosed areas, such as garages or living spaces, will create CO. CO can be produced when burning any fossil fuel: gasoline, diesel, propane, natural gas, oil and wood. It can be produced by any fuel-burning appliance that is malfunctioning, improperly installed, or not ventilated correctly, such as: Furnaces/boilers, gas ranges/stoves, gas clothes dryers, water heaters, portable fuel burning space heaters, fireplaces, wood-burning stoves and certain swimming pool heaters. Blocked chimneys or flues, back drafting and changes in air pressure, corroded or disconnected vent pipes, or a loose or cracked furnace heat exchanger can also release CO into your building.

The following conditions can result in transient CO situations:

Excessive spillage or reverse venting of fuel-burning appliances caused by outdoor ambient conditions such as: Wind direction and/or velocity, including high gusts of wind, heavy air in the vent pipes (cold/humid air with extended periods between cycles), negative pressure differential resulting from the use of exhaust fans, simultaneous operation of several fuel-burning appliances competing for limited internal air, vent pipe connections vibrating loose from clothes dryers, furnaces/boilers, or water heaters, obstructions in, or unconventional, vent pipe designs which can amplify the above situations, extended operation of unvented fuel-burning devices (range, oven, fireplace, etc.), temperature inversions which can trap exhaust gases near the ground, car idling in an open or closed attached garage, or near a home.

CO Safety Tips

Every year, have the heating system, vents, chimney and flue inspected and cleaned by a qualified technician. Always install appliances according to manufacturer's instructions and adhere to local building codes. Most appliances should be installed by professionals and inspected after installation. Regularly examine vents and chimneys for improper connections, visible rust, or

stains, and check for cracks in furnace heat exchangers. Verify that the color of flame is blue on pilot lights and burners. An amber or orange flame is a sign that the fuel is not burning completely and may be releasing CO. Teach all household members what the alarm sounds like and how to respond. Fire Departments, most utility companies and HVAC contractors will perform CO inspections. Some contractors may charge for this service. It's advisable to inquire about any applicable fees prior to having the service performed. Kidde will not pay for, or reimburse the owner or user of this product, for any repair or dispatch calls related to the alarm sounding.

Symptoms of CO Poisoning

Initial carbon monoxide poisoning symptoms are similar to the flu with no fever and can include dizziness, severe headaches, nausea, vomiting and disorientation. Everyone is susceptible but experts agree that unborn babies, pregnant women, senior citizens and people with heart or respiratory problems are especially vulnerable. If symptoms of carbon monoxide poisoning are experienced seek medical attention immediately. CO poisoning can be determined by a carboxyhemoglobin test.

The following symptoms are related to CARBON MONOXIDE POISONING and should be discussed with ALL members of the household:

- 1. MILD EXPOSURE:** Slight headache, nausea, vomiting, fatigue (often described as “Flu-like” symptoms).
- 2. MEDIUM EXPOSURE:** Severe throbbing headache, drowsiness, confusion, fast heart rate.
- 3. EXTREME EXPOSURE:** Unconsciousness, convulsions, cardio respiratory failure and death.

The above levels of exposure relate to healthy adults. Levels differ for those at high risk. Exposure to high levels of carbon monoxide can be fatal or cause permanent damage and disabilities. Many cases of reported carbon monoxide poisoning indicate that while victims are aware they are not feeling well, they become so disoriented they are unable to save themselves by either exiting the building, or calling for assistance. Also, young children and household pets may be the first affected. Familiarization with the effects of each level is important.

15. Cleaning Your Alarm

Your Alarm Should be Cleaned at Least Once a Year

You can clean the interior of your alarm (sensing chamber) by using compressed air or a vacuum cleaner hose and blowing or vacuuming through the openings around the perimeter of the alarm. The outside of the alarm can be wiped with a clean, dry cloth. Do not use water, detergents or cleaners as they may damage the alarm.

NOTE: Do not insert fingers or cleaning items under the shield during cleaning.

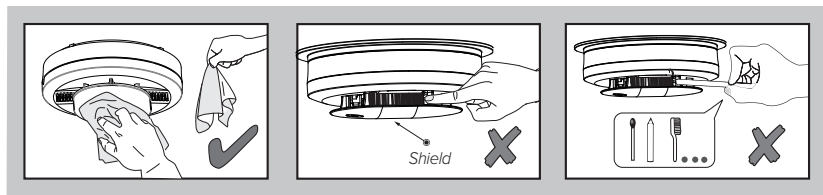


Figure 15

If the alarm is in Fault mode, the alarm may be in need of cleaning. After cleaning, press the Test button. If the fault does not clear, the alarm needs to be replaced.

- Never use detergent or other solvents to clean the unit.
- Avoid spraying air freshener, hair spray, or other aerosols near the alarm.
- Do not use a hair dryer to clean the alarm, as it may damage the alarm and impact performance.
- Do not paint the unit. Paint will seal the vents and interfere with the sensor's ability to detect smoke (smoke only models) or smoke and CO (combination smoke/CO models).
- Never attempt to disassemble the unit to clean inside. This action will void your warranty.

For combination smoke/CO models:

The following substances can affect the CO sensor and may cause false readings and damage to the sensor: Methane, propane, isobutane, iso-propanol, ethyl acetate, hydrogen sulfide, sulfide dioxides, alcohol based products, paints, thinner, solvents, adhesives, hair spray, aftershave, perfume, and some cleaning agents.

Move the Alarm and place in another location prior to performing any of the following:

- Staining or stripping wood floors or furniture
- Painting
- Wall papering
- Using adhesives

Storing the unit in a plastic bag during any of the above projects will protect the sensors from damage. When household cleaning supplies or similar contaminants are used, the area must be well ventilated.

 WARNING: REINSTALL THE ALARM AS SOON AS POSSIBLE TO ENSURE CONTINUOUS DETECTION.

16. Good Safety Habits

Develop and Practice a Plan of Escape

Prepare and practice a home escape plan twice a year, including drills at night. Know two ways out of every room (door & window) and identify a meeting place outside the home where everyone will gather once they have exited the residence. When two people have reached the meeting place, one should leave to call 911 while the second person stays to account for additional family members. Establish a rule that once you're out, you never re-enter under any circumstance!

- Make a floor plan indicating all doors and windows and at least two (2) escape routes from each room. Stories above ground level may need a rope or chain ladder.
- Have a family meeting and discuss your escape plan, showing everyone what to do in case of fire and where to meet after they leave the house.
- Ensure that small children hear the alarm and wake when it sounds. They must wake up in order to execute the escape plan. Practice allows all occupants to test your plan before an emergency. You may not be able to reach your children. It is important they know what to do.
- Familiarize everyone with the sounds of the smoke/CO alarm and train them to leave your home when they hear it.
- Current studies have shown smoke/CO alarms may not awaken all sleeping individuals, and that it is the responsibility of individuals in the household that are capable of assisting others to provide assistance to those who may not be awakened by the alarm sound, or to those who may be incapable of safely evacuating the area unassisted.
- Install and maintain fire extinguishers on every level of the home and in the kitchen, basement and garage. Know how to use a fire extinguisher prior to an emergency.

Fire Prevention

Never smoke in bed or leave cooking food unattended. Teach children never to play with matches or lighters! Train everyone in the home to recognize the smoke alarm pattern and to leave the home using their escape plan when it's heard. Know how to do "Stop, Drop and Roll" if clothes catch on fire, and how to crawl low under smoke. Install and maintain fire extinguishers on every level of the home and in the kitchen, basement and garage.

NFPA (National Fire Protection Association)

Fire Safety in the Home: NFPA 72 is intended to provide reasonable safety for persons in family living units. Reasonable fire safety can be produced through the following three-point program: (1) Minimizing fire hazards (2) Providing fire-warning equipment (3) Having and practicing an escape plan.

Smoke Detection – Are More Alarms Desirable?

The required number of smoke alarms might not provide reliable early warning protection for those areas separated by a door from the areas protected by the required smoke alarms. For this reason, it is recommended that the resident consider the use of additional smoke alarms for those areas for increased protection. The additional areas include the basement, bedrooms, dining room, furnace room, utility room, and hallways not protected by the required smoke alarms. The installation of smoke alarms in attics (finished or unfinished), garages, or within 6 ft (1.8m) of a heating or cooking appliance is not normally recommended, as these locations occasionally experience conditions that can result in improper operation. *

* Reference National Fire Protection Association (NFPA) standard 72

For your information, the National Fire Protection Association's Standard 72 reads: Where required by other governing laws, codes, or standards for a specific type of occupancy, approved single and multiple-station smoke alarms shall be installed as follows:

1. In all sleeping rooms and guest rooms
2. Outside of each separate dwelling unit sleeping area, within 21 ft (6.4 m) of any door to a sleeping room, with the distance measured along a path of travel
3. On every level of a dwelling unit, including basements
4. On every level of a residential board and care occupancy (small facility), including basements and excluding crawl spaces and unfinished attics
5. In the living area(s) of a guest suite
6. In the living area(s) of a residential board and care occupancy (small facility)

California State Fire Marshal

Early warning fire detection is best achieved by the installation of fire detection equipment in all rooms and areas of the household as follows: A smoke alarm installed in each separate sleeping area (in the vicinity, but outside the bedrooms), heat or smoke detectors in the living rooms, dining rooms, bedrooms, kitchens, hallways, attics, furnace rooms, closets, utility and storage rooms, basements and attached garages.

FCC

This device complies with part 15 of the FCC Rules. Operation is subject to the following two conditions: (1) This device may not cause harmful interference, and (2) this device must accept any interference received, including interference that may cause undesired operation.

⚠ WARNING! Changes or modifications not expressly approved by the party responsible for compliance could void the user's authority to operate this device.

NOTE: This equipment has been tested and found to comply with the limits for a Class B digital device, pursuant to part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference in a residential installation. This equipment generates, uses, and can radiate radio frequency energy and, if not installed and used in accordance with the instructions, may cause harmful interference to radio communications. However, there is no guarantee that interference will not occur in a particular installation. If this equipment does cause harmful interference to radio or television reception, which can be determined by turning the equipment off and on, the user is encouraged to try to correct the interference by one or more of the following measures:

- Reorient or relocate the receiving antenna.
- Increase the separation between the equipment and receiver.
- Connect the equipment into an outlet on a circuit different from that to which the receiver is connected.
- Consult the dealer or an experienced radio/TV technician for help.

17. Service And Warranty

Ten-Year Limited Warranty

Kidde warrants that the enclosed alarm (but not the AA replaceable batteries on AA battery models) will be free from defects in material and workmanship or design under normal use and service for a period of ten years from the date of purchase. The obligation of Kidde under this warranty is limited to repairing or replacing the alarm or any part which we find to be defective in material, workmanship or design (part replacement only, no installation), free of charge, upon receiving the alarm with proof of date of purchase, postage and return postage prepaid, to Warranty Service Department, Kidde, 1016 Corporate Park

Drive, Mebane, NC 27302. Before shipping the product, please remove the batteries from the battery compartment, or follow the steps in Permanently Disable Alarm / Discharge Battery section, depending your model type.

This warranty shall not apply to the alarm if it has been damaged, modified, abused or altered after the date of purchase or if it fails to operate due to improper maintenance or inadequate power. Any implied warranties arising out of this sale, including but not limited to the implied warranties of description, merchantability and fitness for a particular purpose, are limited in duration to the above warranty period. In no event shall the Manufacturer be liable for loss of use of this product or for any indirect, special, incidental or consequential damages, or costs, or expenses incurred by the consumer or any other user of this product, whether due to a breach of contract, negligence, strict liability in tort or otherwise.

The above warranty may not be altered except in writing signed by both parties hereto. Your Kidde Alarm is not a substitute for property, fire, disability, life or other insurance of any kind. Appropriate insurance coverage is your responsibility. Consult your insurance agent. Opening the unit will void the warranty. If there are any differences between this printed warranty and the online limited warranty, then the terms of the online warranty supersede those in this user guide or other printed materials. Visit www.kidde.com for the latest warranty statement.



QUESTIONS OR FOR MORE INFORMATION

Call Kidde Product Support line at **1-800-880-6788**
or contact us at www.kidde.com

Kidde

1016 Corporate Park Drive, Mebane, NC 27302

©2024 Kidde. All Rights Reserved.