

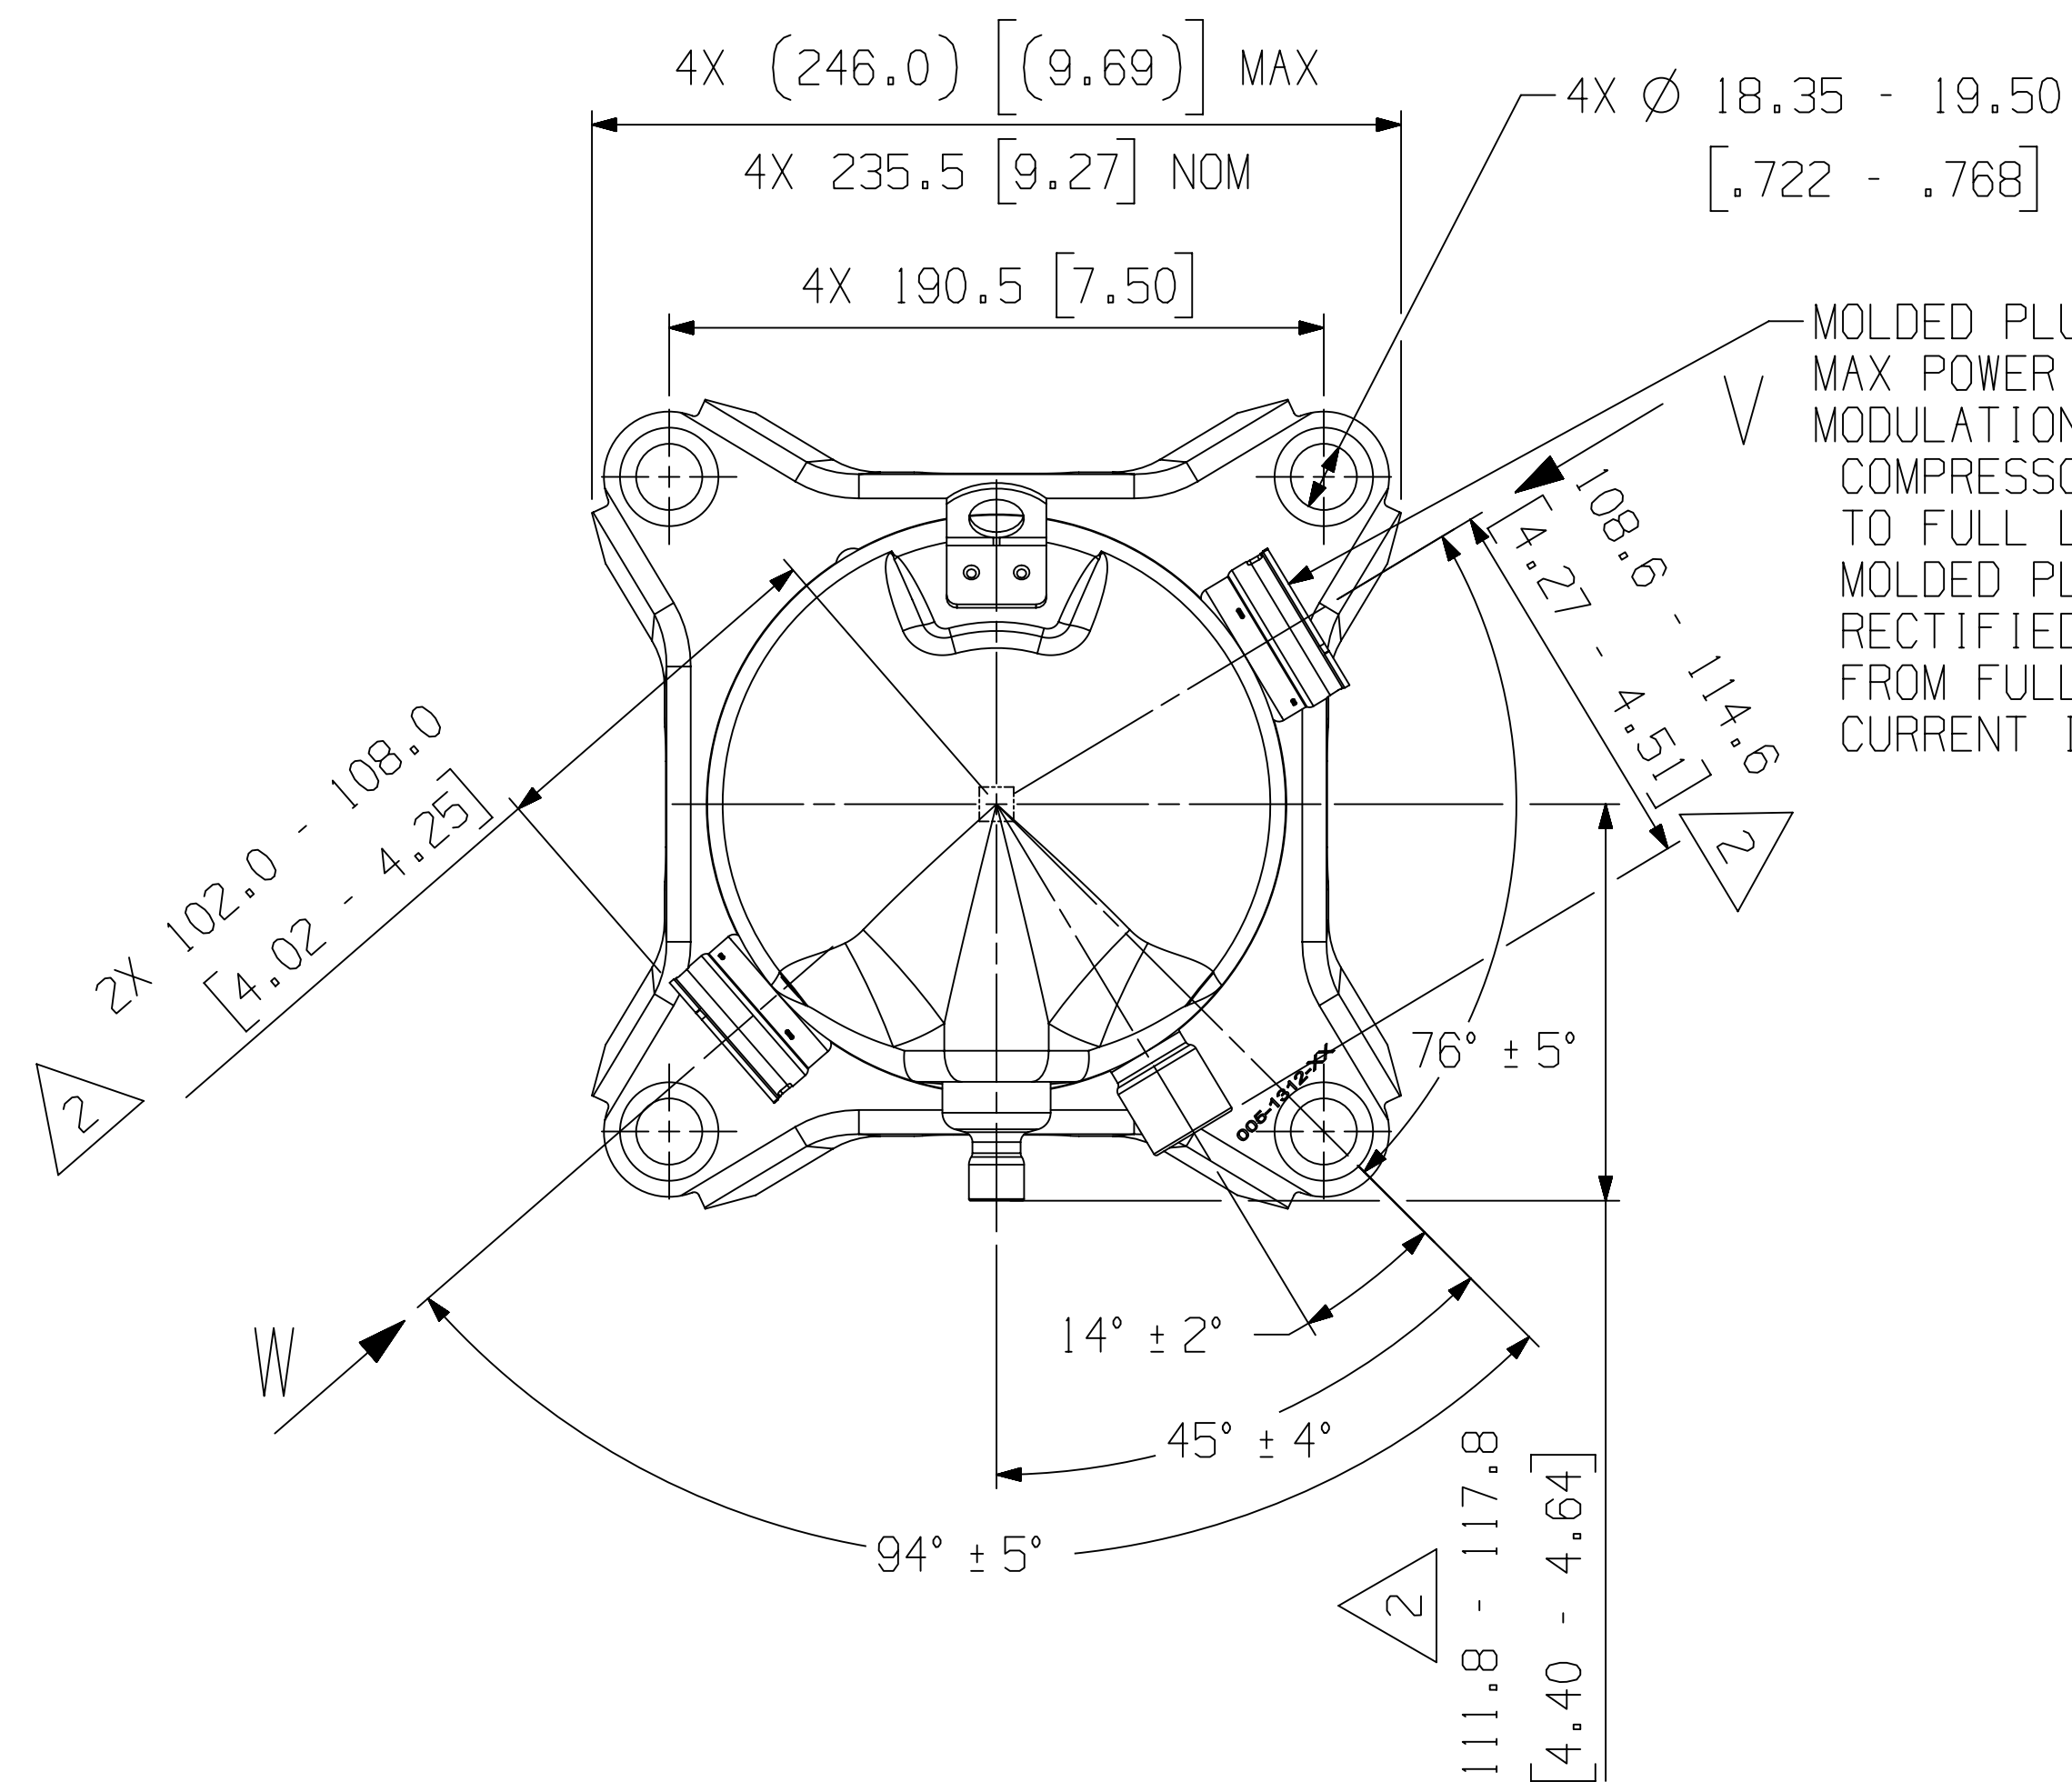
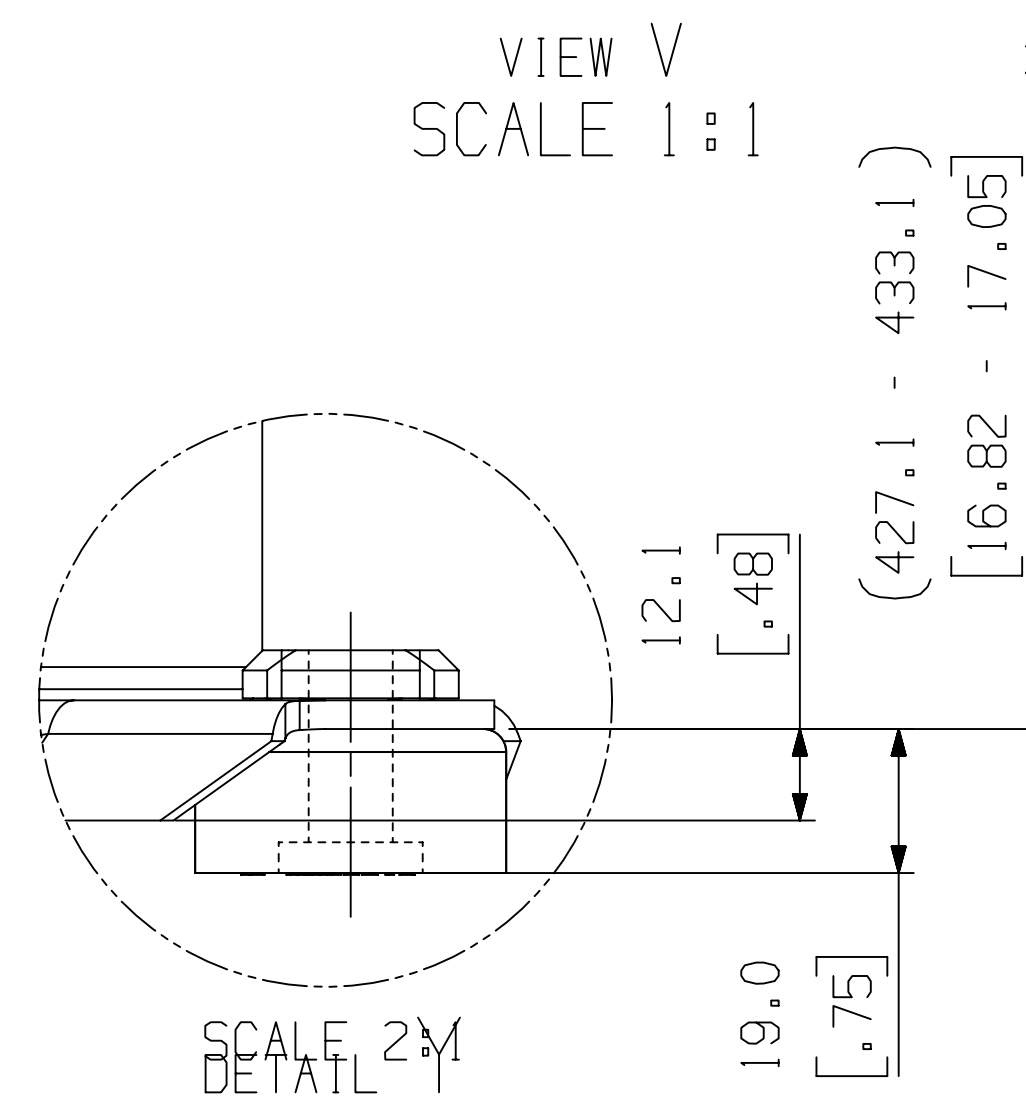
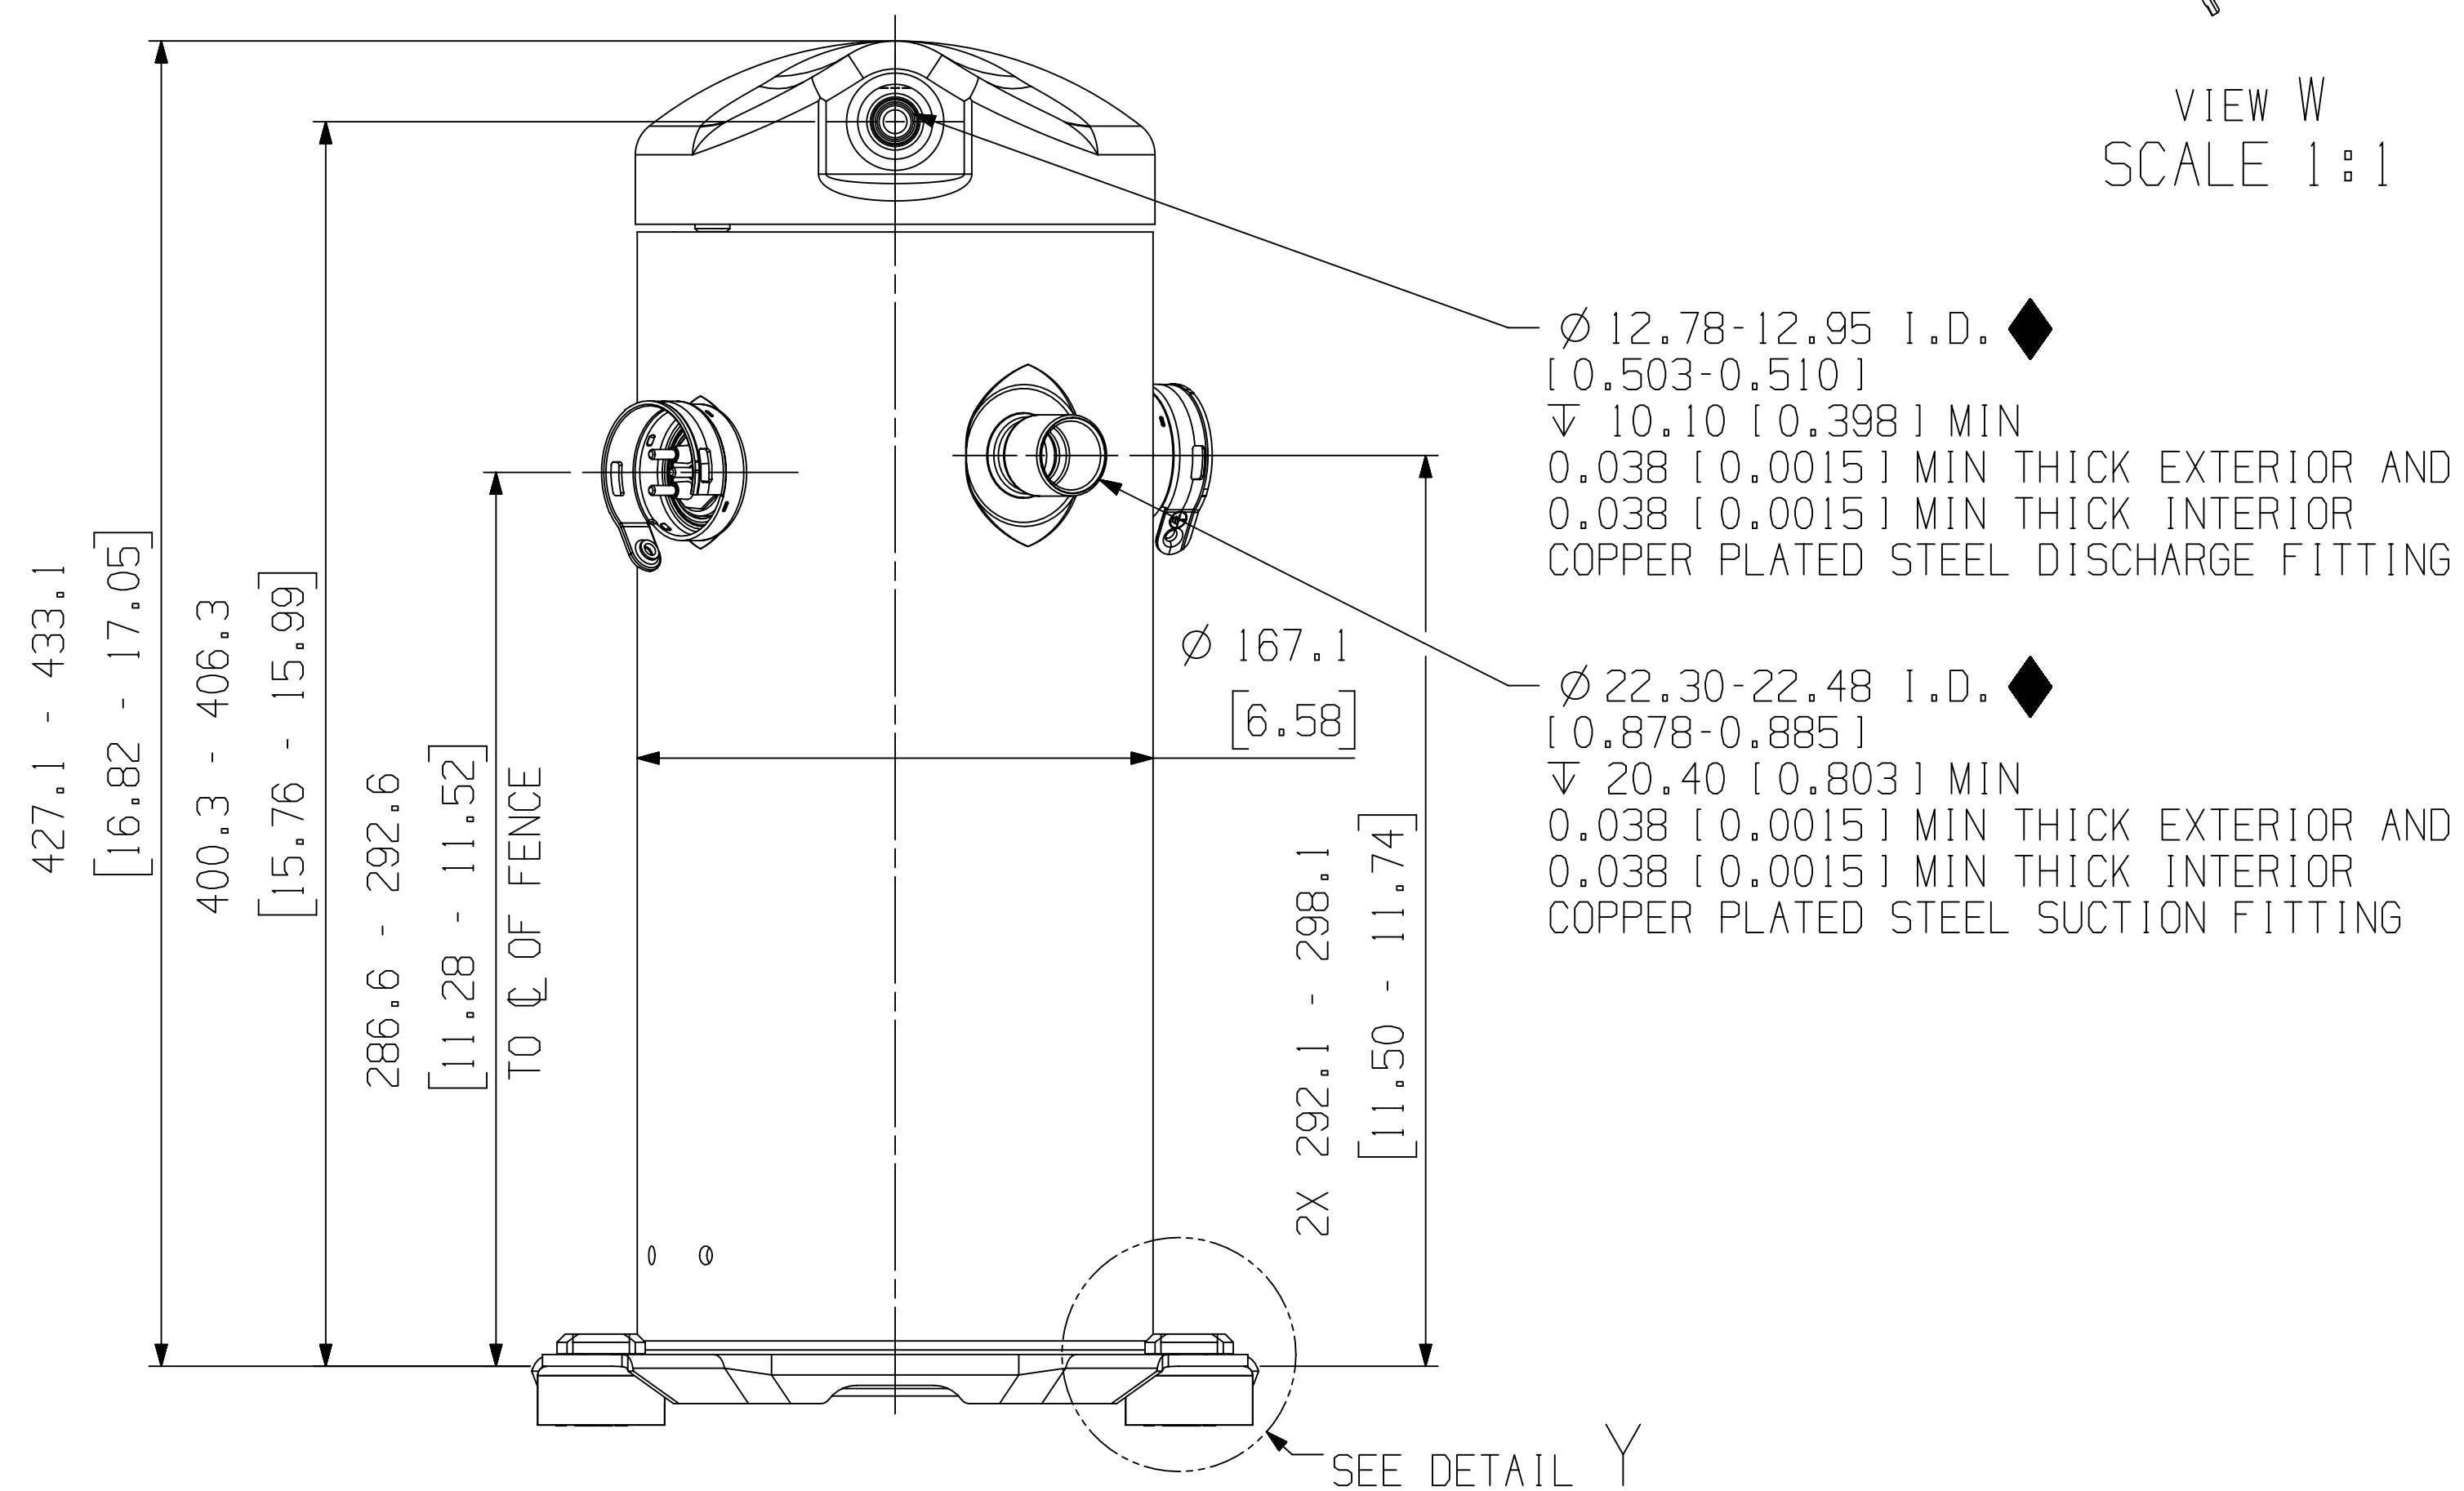


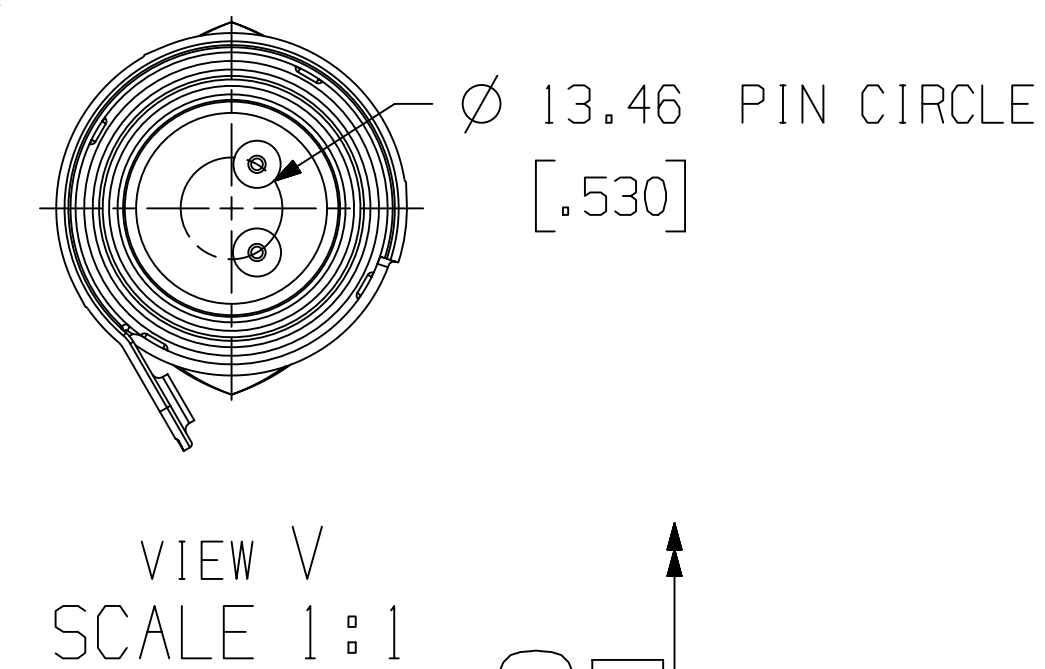

-MOLDED PLUG SHOULD BE USED AT ALL TIMES
MAX POWER = 5 VA
MODULATION CONTROL INPUT SPECIFICATIONS:
COMPRESSOR WILL MODULATE FROM PART LOAD
TO FULL LOAD WHEN VOLTAGE SUPPLIED TO
MOLDED PLUG IS 18-28 VDC OR 18-28 VAC
RECTIFIED TO VDC COMPRESSOR WILL MODULATE
FROM FULL LOAD TO PART LOAD WHEN THE
CURRENT IN THE CIRCUIT DROPS BELOW 0.9MA

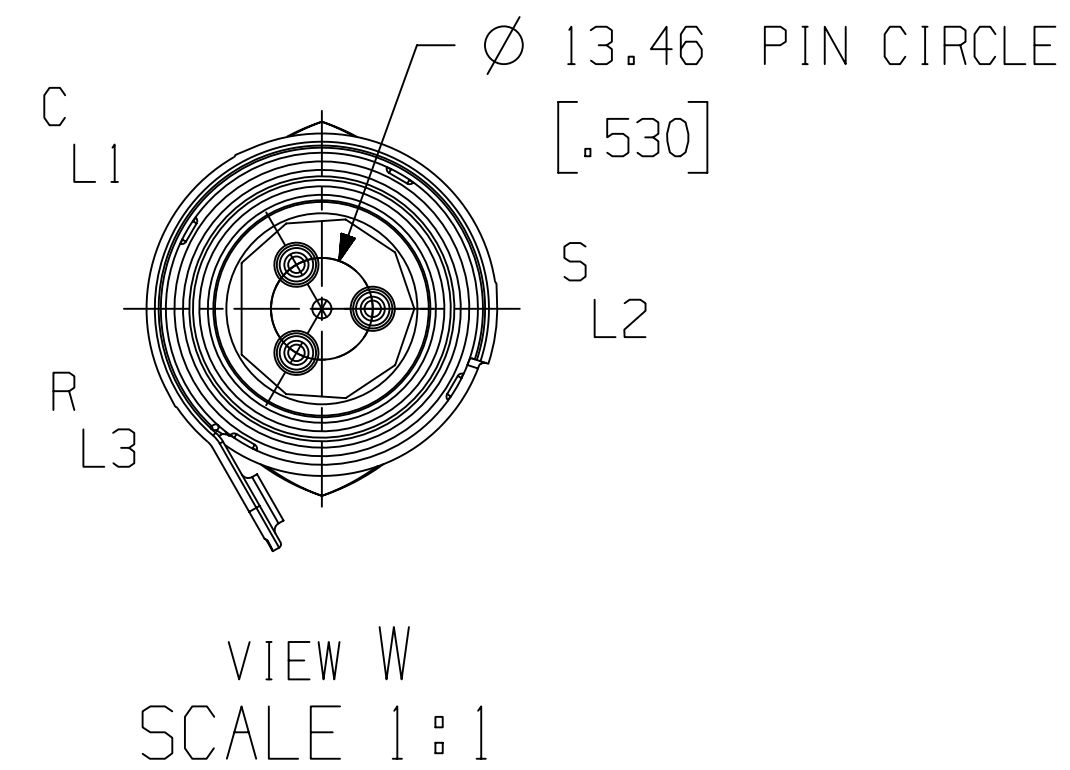

MODEL NUMBER
YAS35K1E-PFV/TF5
YAS40K1E-PFV/TF5
YAS42K1E-PFV/TFD/TF5
YAS49K1E-PFV/TFD/TF5
YAS51K1E-PFV/TFD/TF5
YAS60K1E-PFV/TF5
YPS35K1T-PFV
YPS40K1T-PFV/TFD/TFE/TF5
YPS51K1T-PFV/TF5
YPS60K1T-PFV/TFD/TFE

MODEL NUMBER
ZPS35K7E - PFV
ZPS40K7E - PFV/TFE/TFD/TF5
ZPS42K7E - PFV
ZPS49K7E - PFV/TFD/TFE/TF5
ZPS51K7E - PFV/TFD/TFE/TF5
ZPS38LXE - TF5/TFD
ZPS39LXE - PFV
ZPS44LXE - PFV
ZPS46LXE - TFD
ZPS63LXE - PFV

SPECIFICATIONS	
ES NO.	DESCRIPTION
ES92-155	CONVERSION-METRIC

NOTES:




1 ALL TOLERANCES $\pm 1.5 [0.06]$
UNLESS OTHERWISE SPECIFIED.

2 THE SUCTION TUBE, DISCHARGE TUBE, AND CIRCLE FENCE RADIAL DIMENSIONS ARE TO BE GAUGED FROM THE CENTER OF THE MOUNTING HOLE PATTERN.

3. TUBE ENDS MUST BE PLUGGED.

4. MOUNTING KIT.

GROMMET DUROMETER	4 FOOT KIT
35-45	527-0116-00

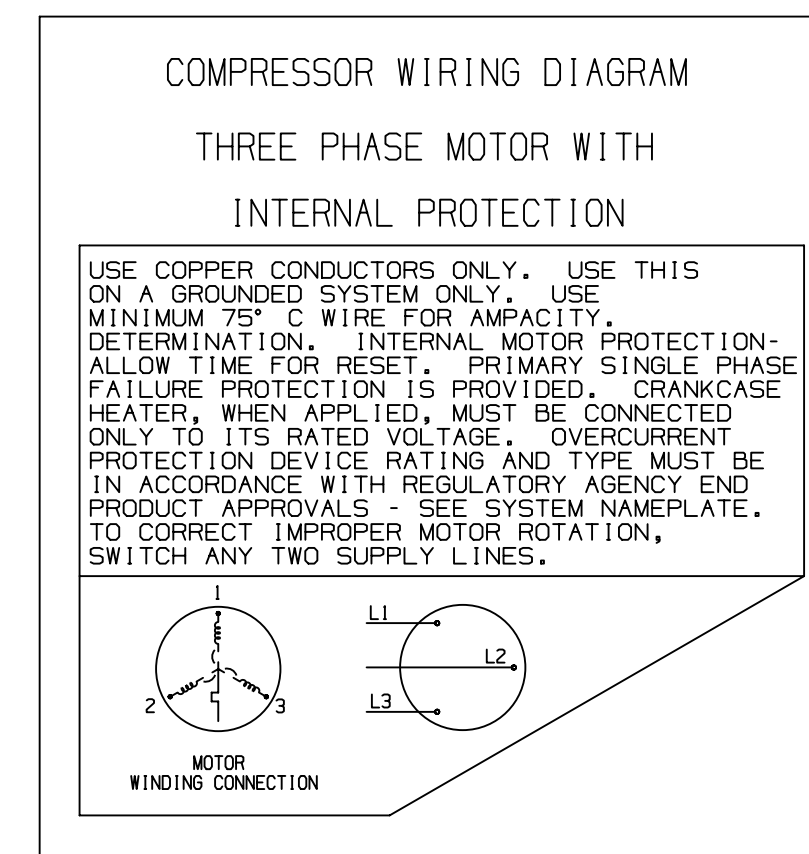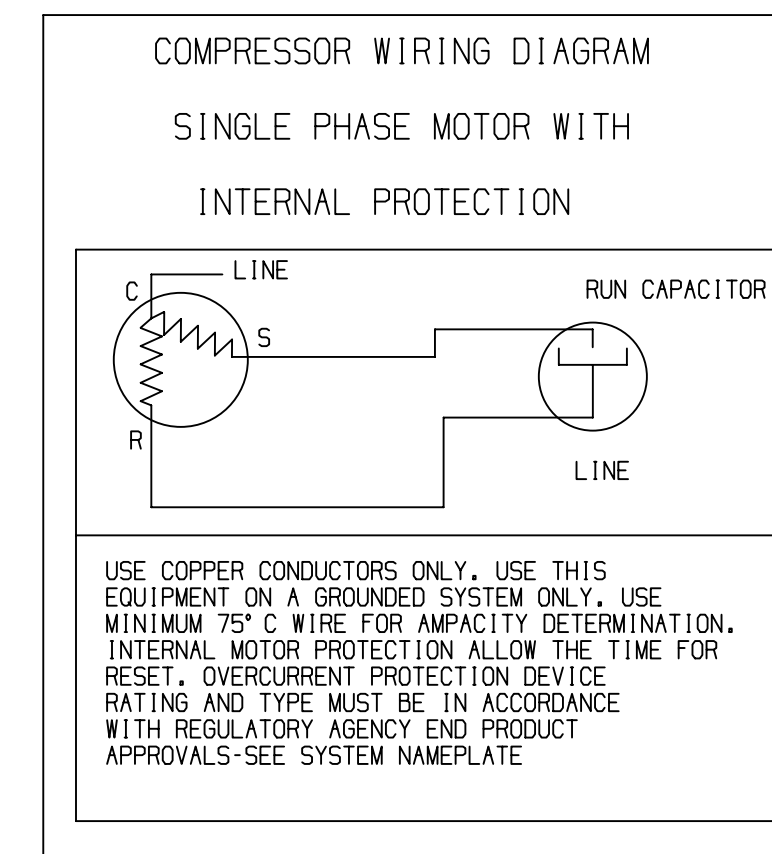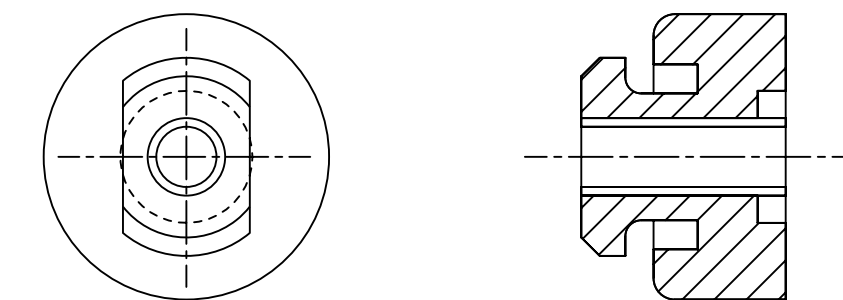

ECN330224	21	ADD ZPS46LXE	01-15-25	RAD	M
ECN329379	20	ADD LXE MODELS	11-26-24	RAD	M
ECN316045	0	RELEASED	11-20-20	VPV	PE
ENG NOTICE NO.	REV.NO.	REVISIONS	DATE	BY	CHK

24 THIS DRAWING AND INFORMATION CONTAINED HEREIN ARE THE EXCLUSIVE PROPERTY OF COPELAND LP AND/OR ITS AFFILIATES (COLLECTIVELY "COPELAND") AND SHALL BE RETURNED UPON DEMAND AND SHALL NOT BE REPRODUCED IN WHOLE OR IN PART, DISCLOSED TO ANYONE ELSE OR USED, WITHOUT THE WRITTEN CONSENT OF COPELAND.

	MATERIAL SPECIFICATION	DRAWN BY MA	SUPERSEDES DWG NO / REV NO 497-1059-00 / 018
	N/A	DATE 05-28-24	SCALE 1:2
			DATE FORM MM-DD-YY

TITLE	DRAWING NUMBER	SHEET 1 OF 1
REF DWG-WELD COMP ASSM	497-3511-00	

